


OPTION 2
REPLACE EQUIPMENT-DECENTRALIZED DX COOLING

ZTECH ENGINEERS, INC.
 40 D Weston Street
 Hartford, Ct. 06120
 Phone (860) 438-5857
 Fax (860) 438-2572
 www.ztecheng.com

BEECHER ROAD SCHOOL
HVAC SYSTEM STUDY
 40 BEECHER ROAD WEST
 WOODBRIDGE, CONNECTICUT

HVAC STUDY
FLOOR PLANS
OPTION 2
REPLACE EQUIPMENT
DECENTRALIZED DX COOLING

Project	06022
Date	10/11/05
Sheet	M-2
AS NOTED	

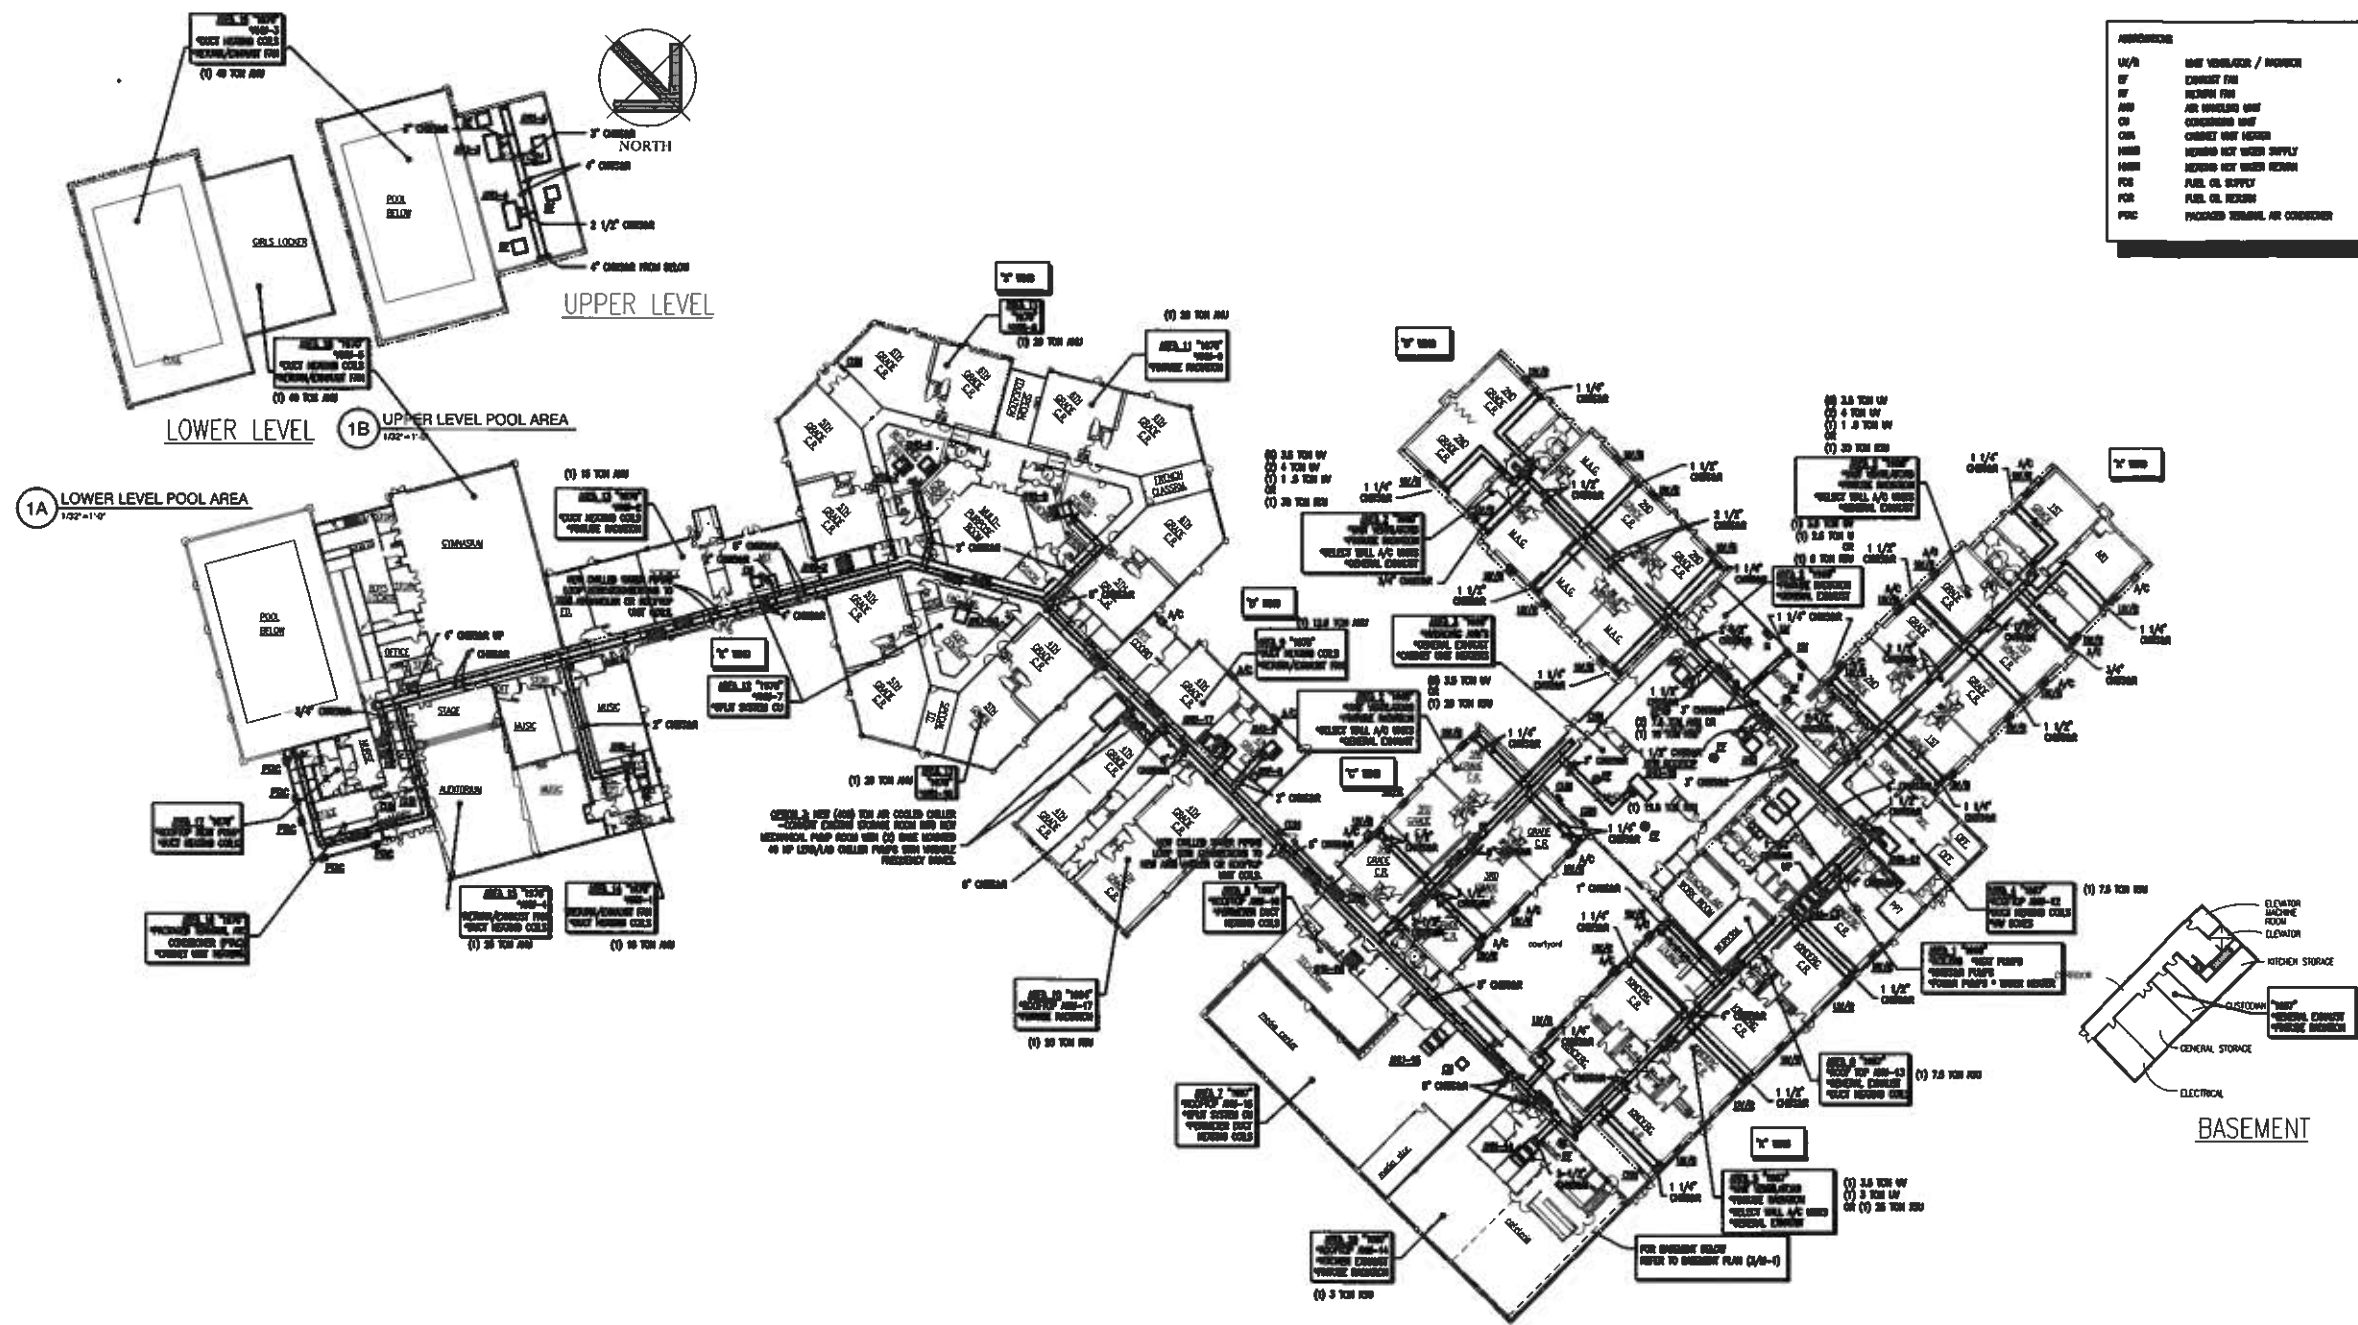

OPTION 3
REPLACE EQUIPMENT-CENTRALIZED CHILLED WATER COOLING

ZTECH ENGINEERS, INC.
 40 D Weston Street
 Hartford, Ct. 06120
 Phone (860)548-9957
 Fax (860)548-2372
 www.ztecheng.com

BEECHER ROAD SCHOOL
HVAC SYSTEM STUDY
40 BEECHER ROAD WEST
WOODBIDGE, CONNECTICUT

HVAC STUDY
FLOOR PLANS
OPTION 3
REPLACE EQUIPMENT - CENTRALIZED
CHILLED WATER COOLING

Project	06022
Date	11/1/06
AS NOTED	M-3